

Figure S1. The ITC profiles at 10mM phosphate buffer, 25mM NaCl, pH 6.5, 20°C (A) L-Arm (B) D-Arm

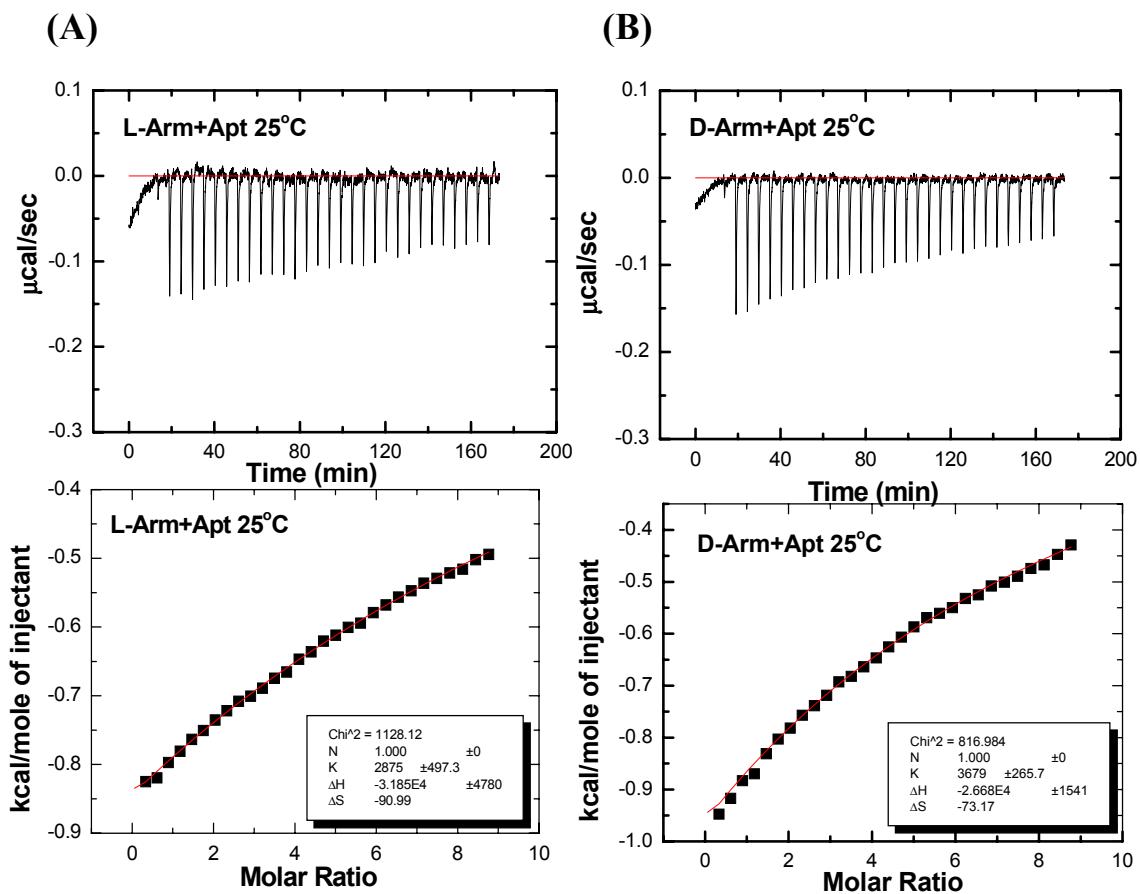


Figure S2. The ITC profiles at 10mM phosphate buffer, 25mM NaCl, pH 6.5, 25°C (A) L-Arm (B) D-Arm

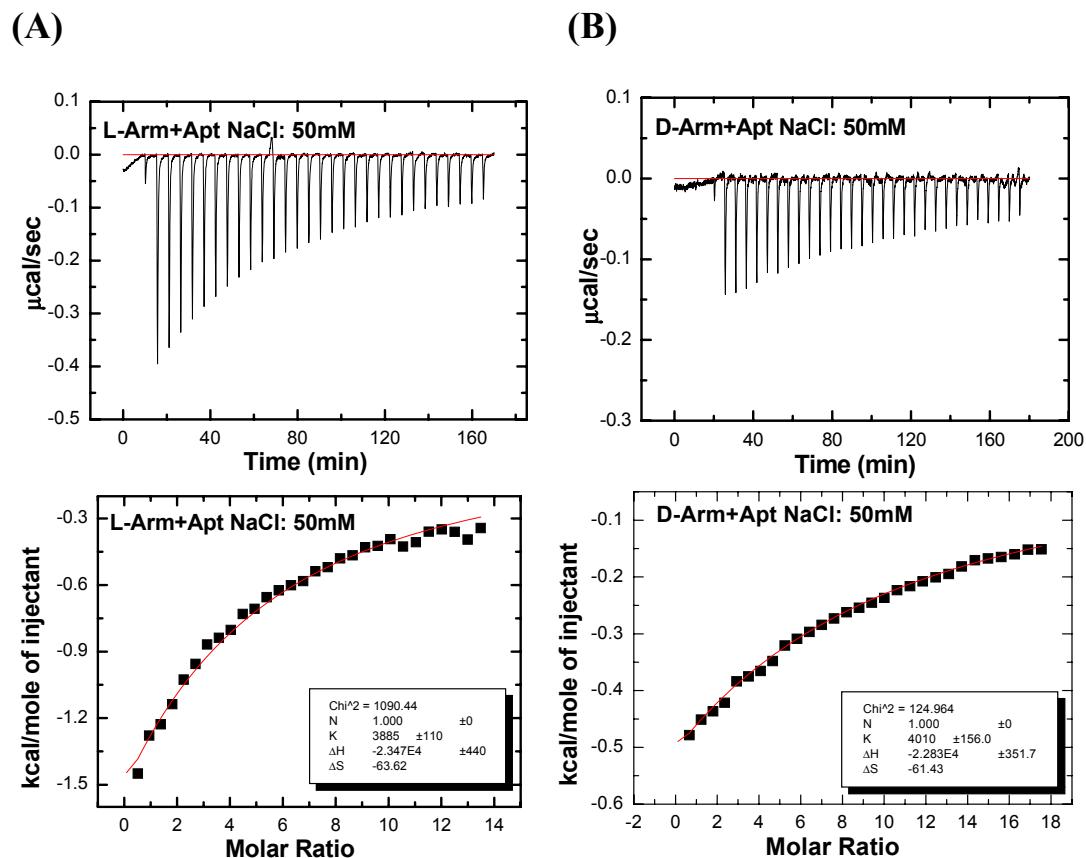


Figure S3. The ITC profiles at 10mM phosphate buffer, 50mM NaCl, pH 6.5, 20°C (A) L-Arm (B) D-Arm

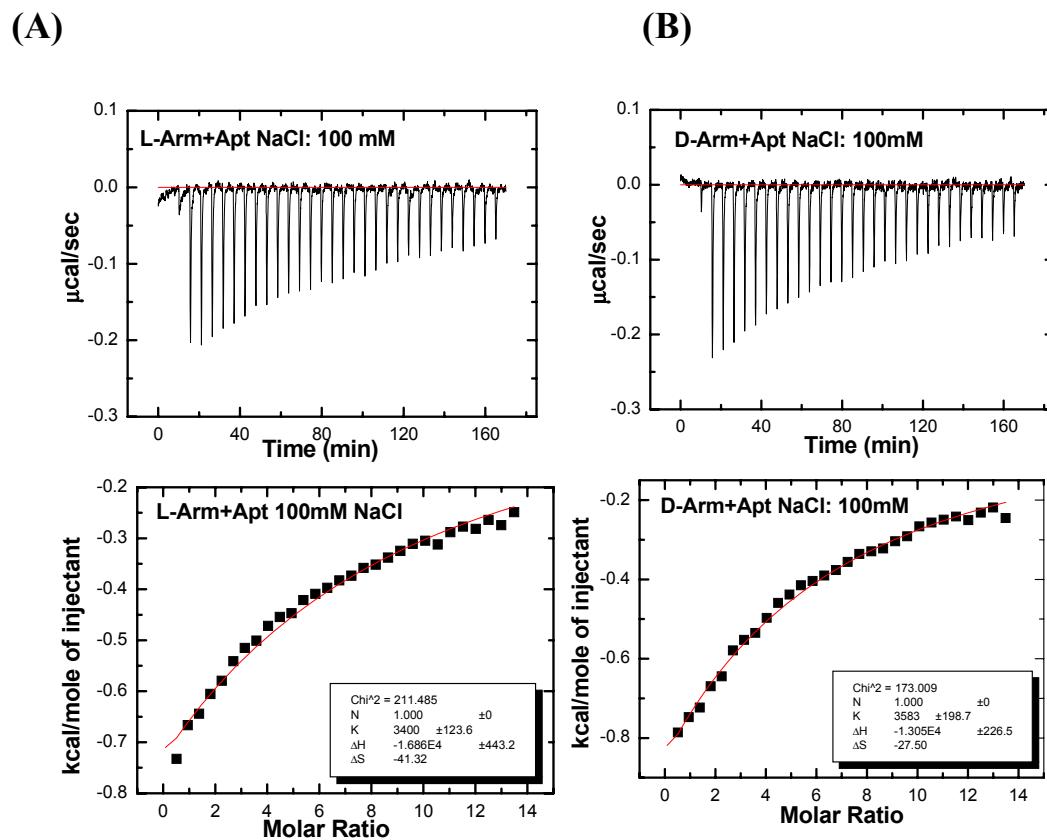


Figure S4. The ITC profiles at 10mM phosphate buffer, 100mM NaCl, pH 6.5, 20°C (A) L-Arm (B) D-Arm

Electronic Supplementary Material for PCCP

This Journal is © The Owner Societies 2009

(A)

(B)


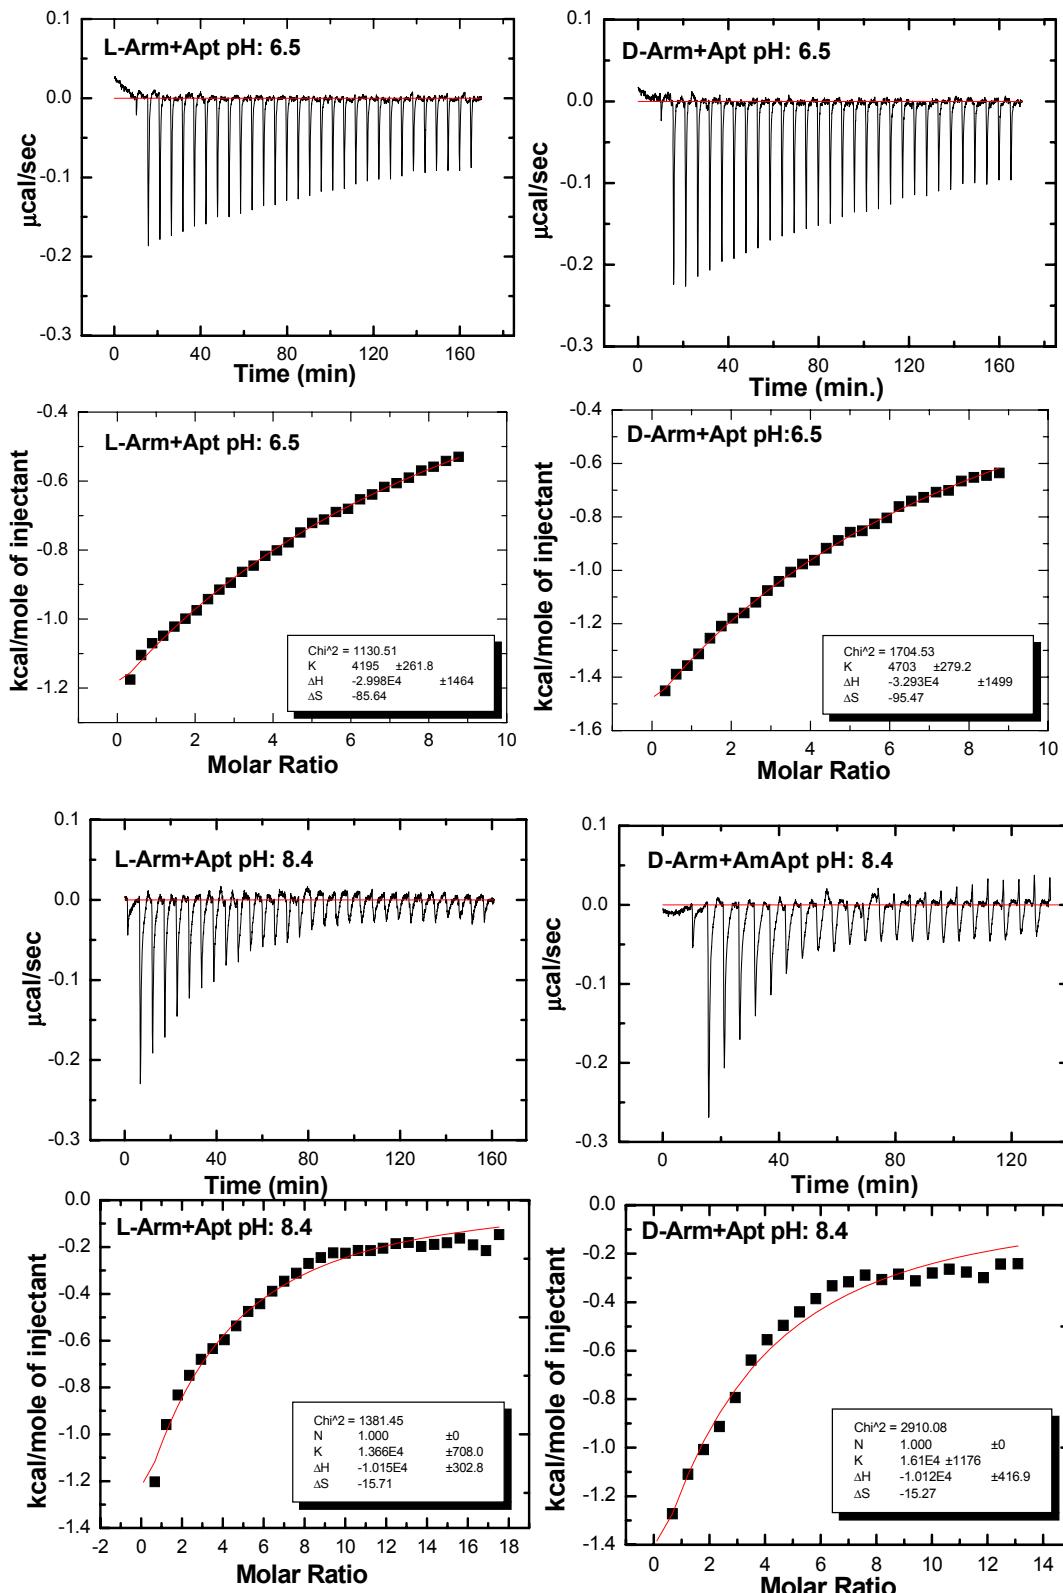


Figure S4. The ITC profiles at 10mM phosphate buffer, 100mM NaCl, pH 6.5 & 8.4 , 20°C (A) L-Arm (B) D-Arm

(A)

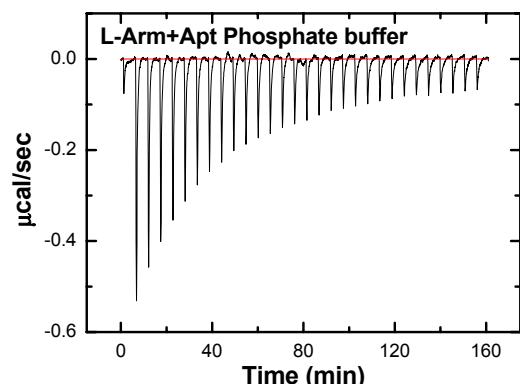

(B)

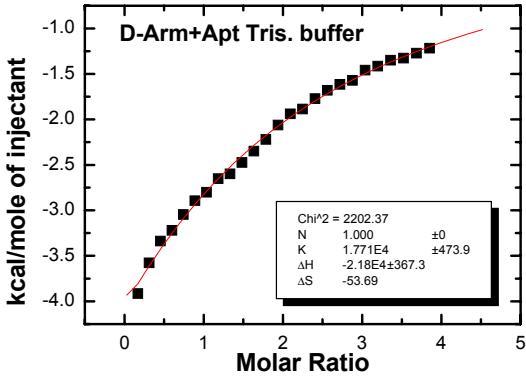
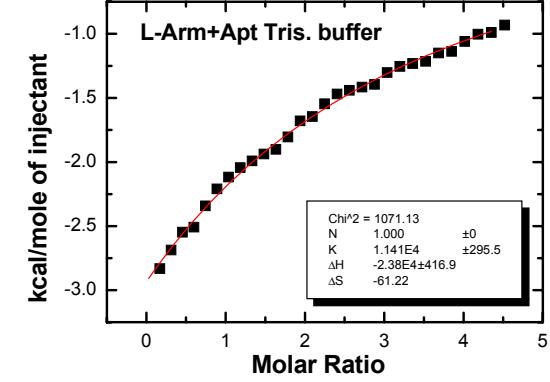
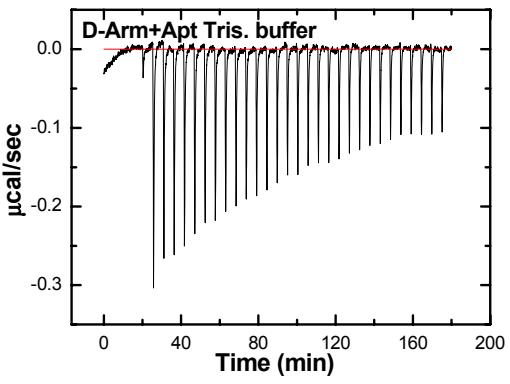
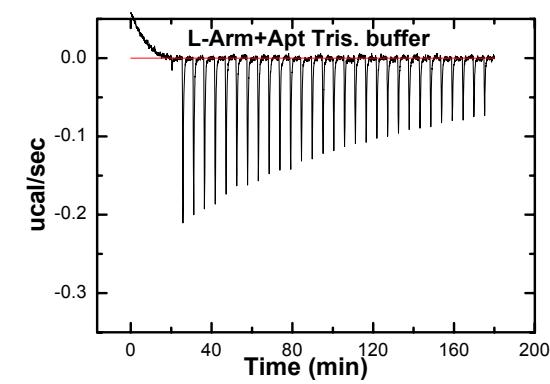
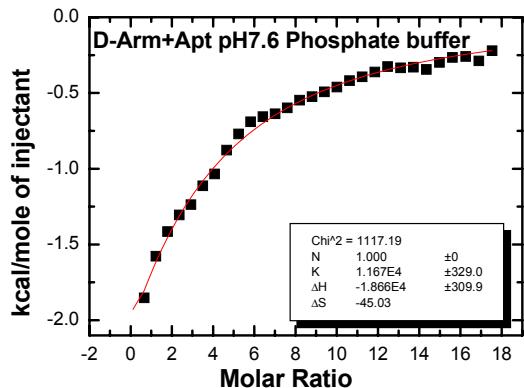
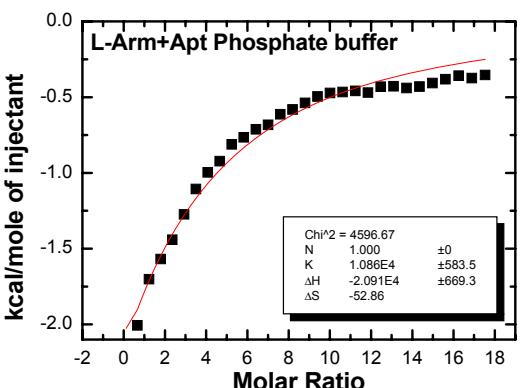
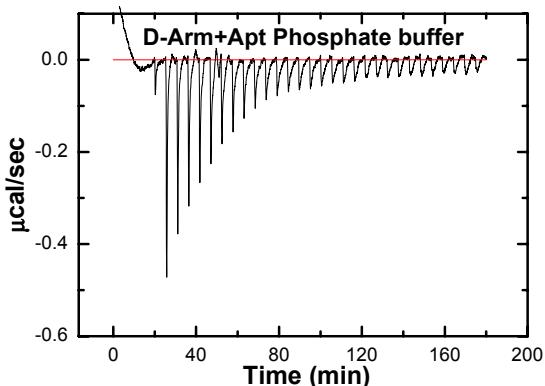


Figure S4. The ITC profiles at 10mM phosphate & Tris buffer, 100mM NaCl, pH 7.6, 20°C (A) L-Arm (B) D-Arm